




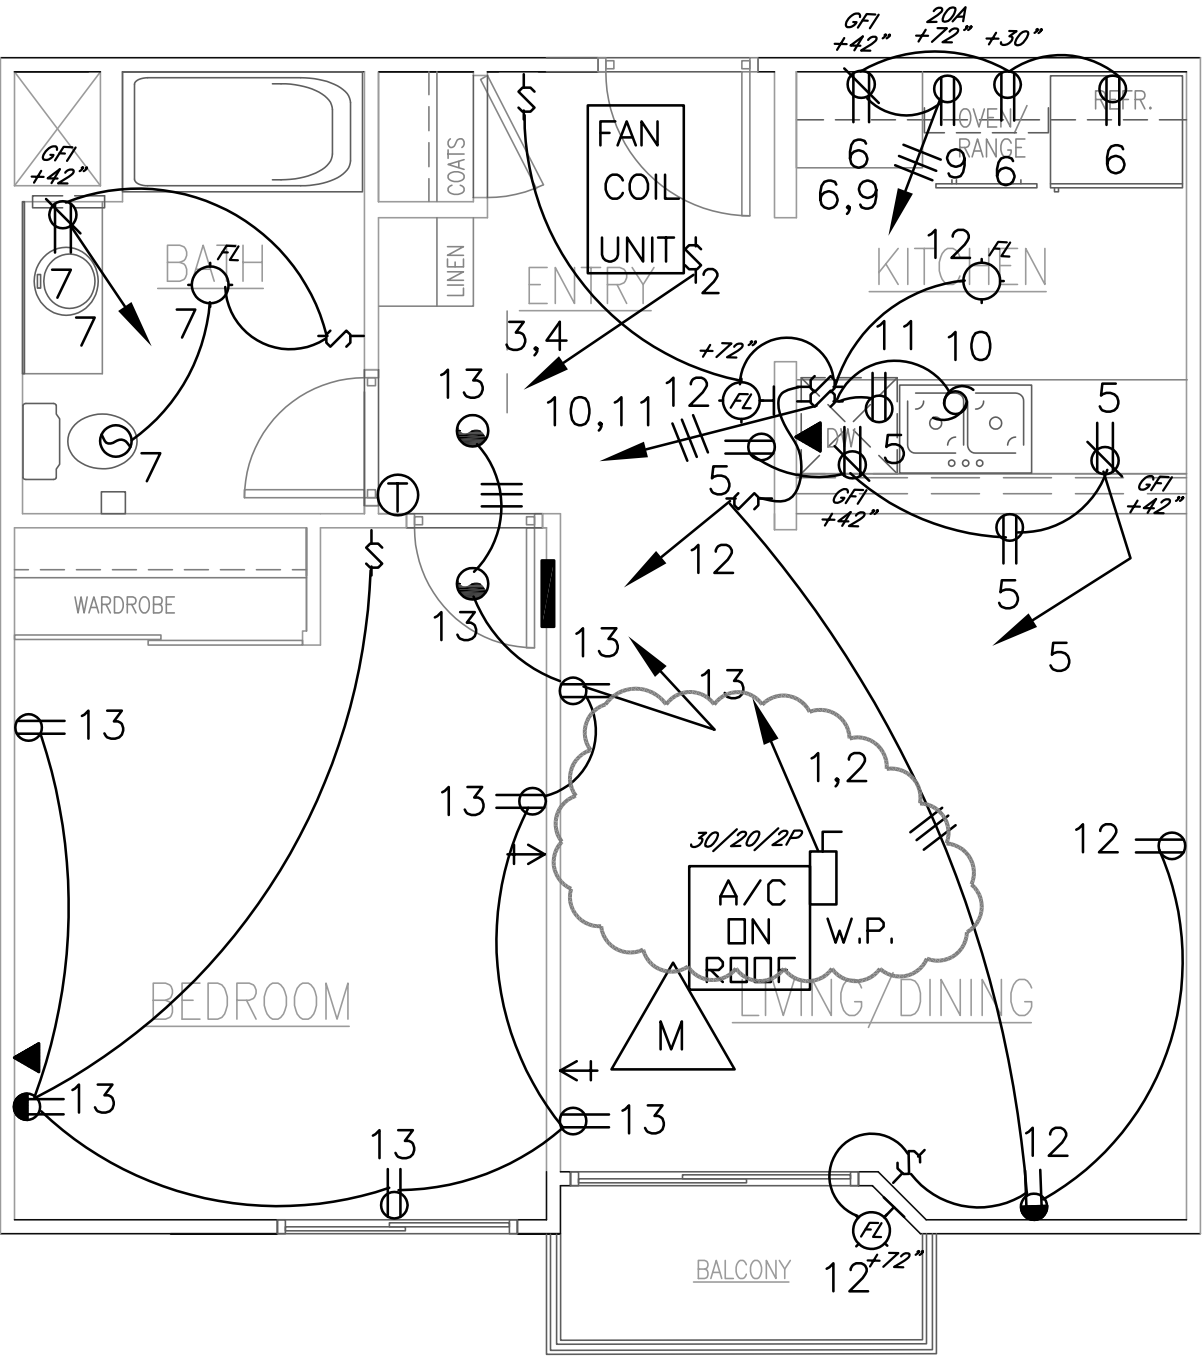


FLOOR PLAN ROOM TYPE "F1"
UNITS 224, 324, 424

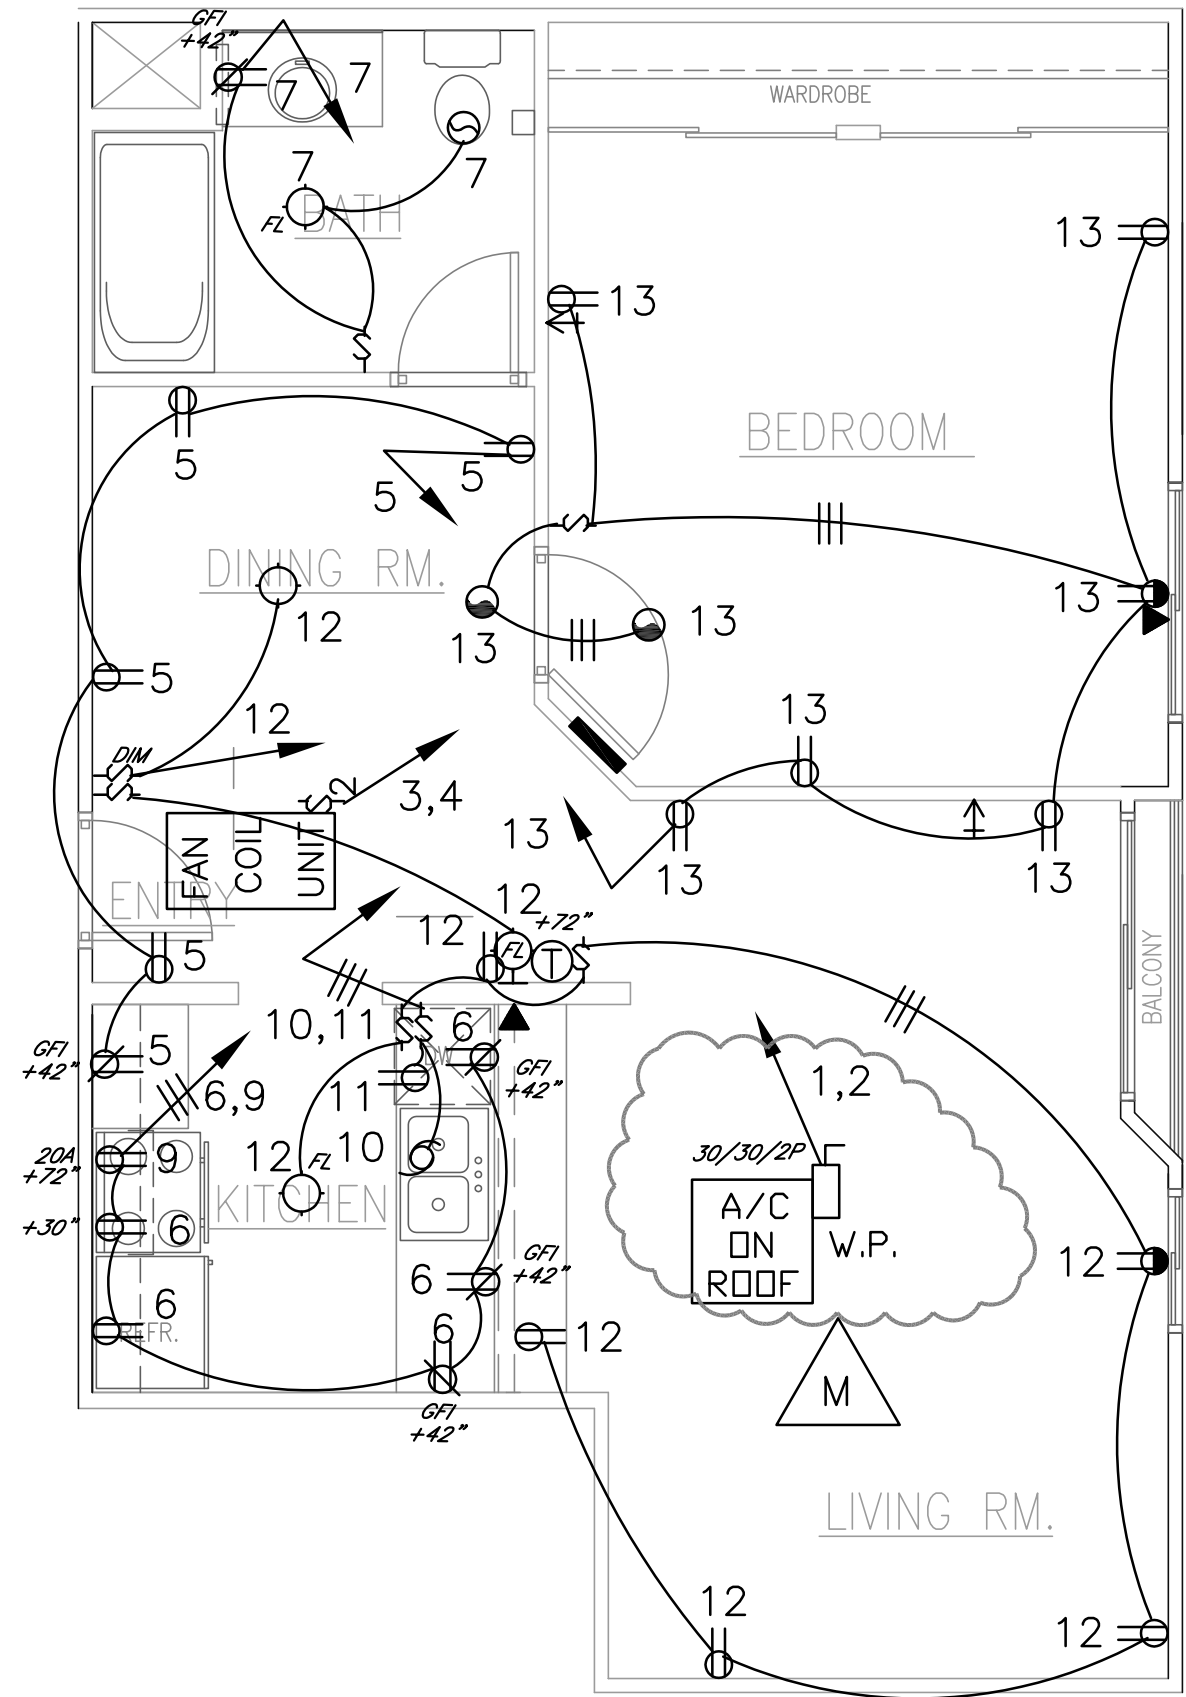


FLOOR PLAN ROOM TYPE "E"
UNITS 220, 320, 420

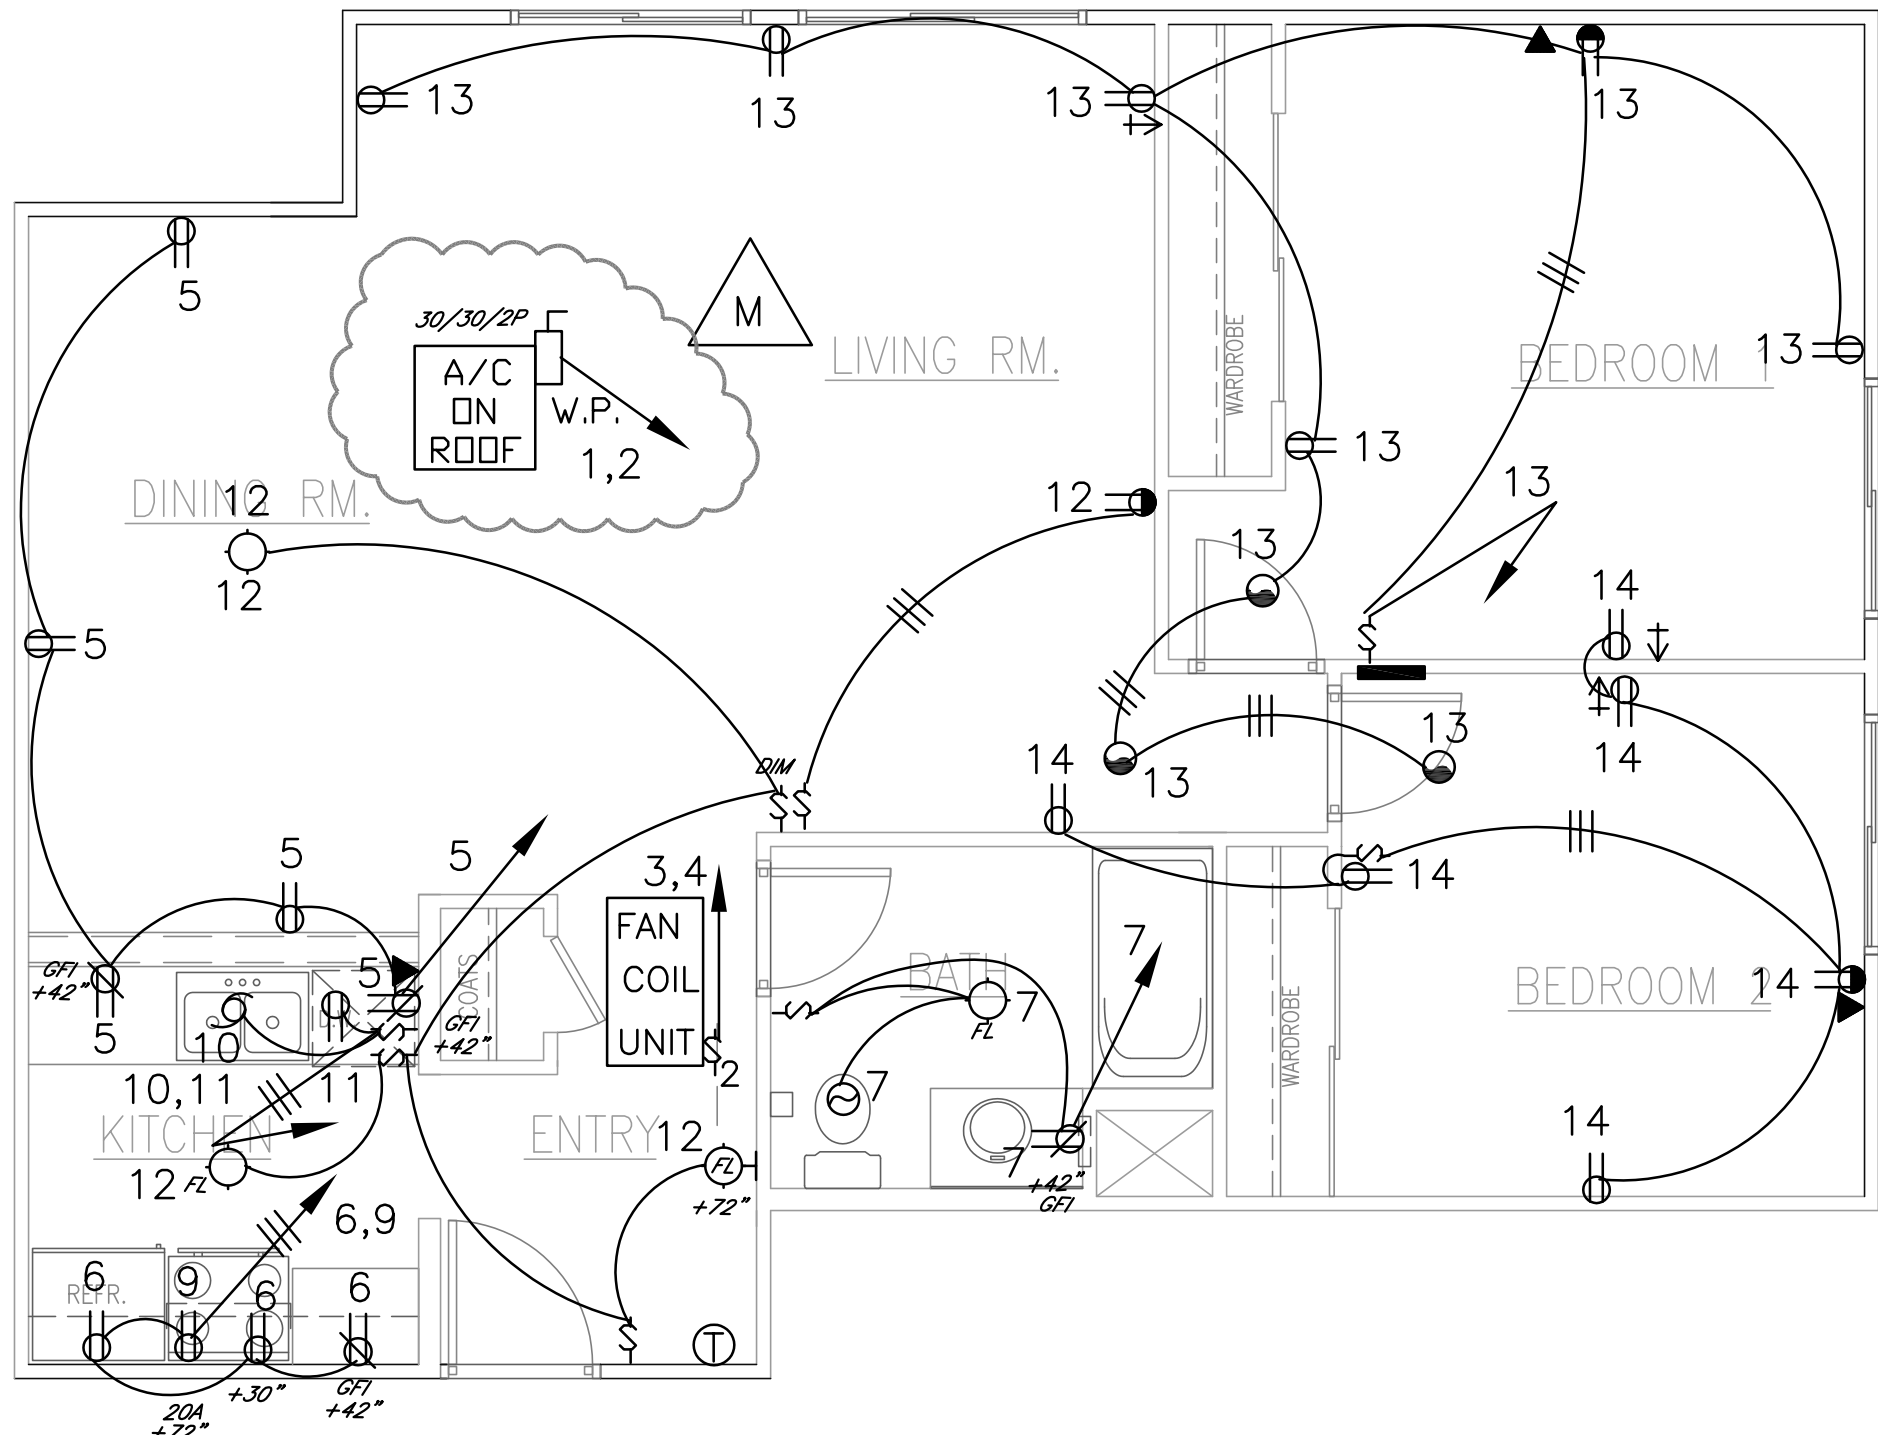


FLOOR PLAN ROOM TYPE "C"
UNITS 109, 116, 209, 216, 309, 316

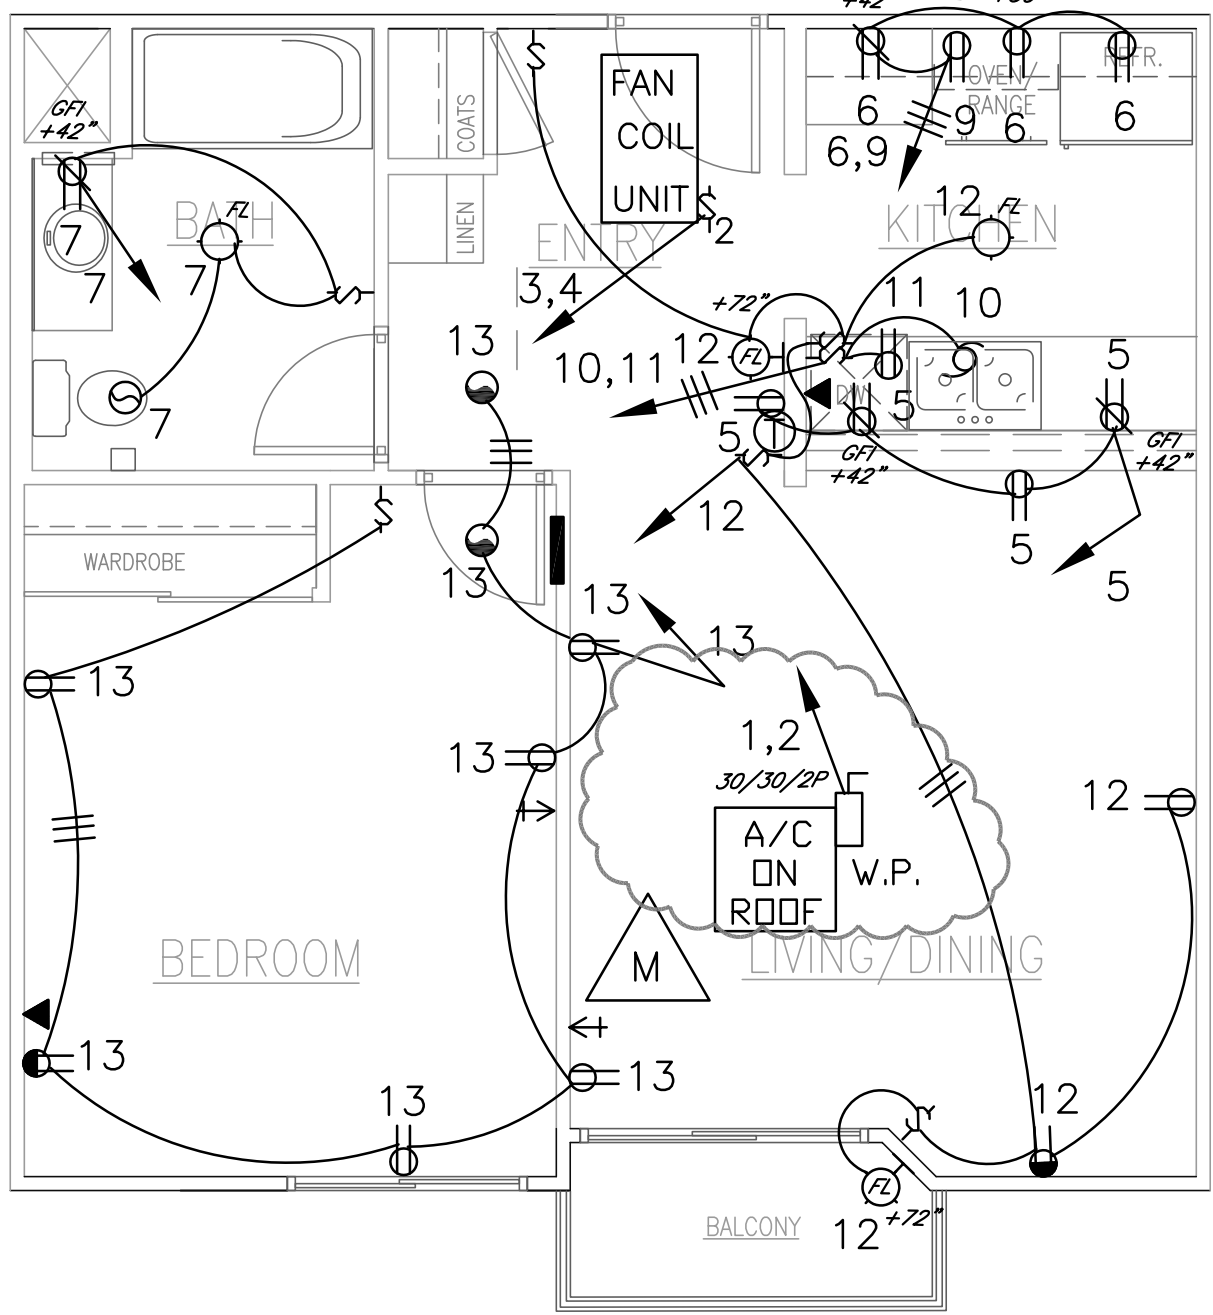

FLOOR PLAN ROOM TYPE "F2"
UNITS 225, 325, 425

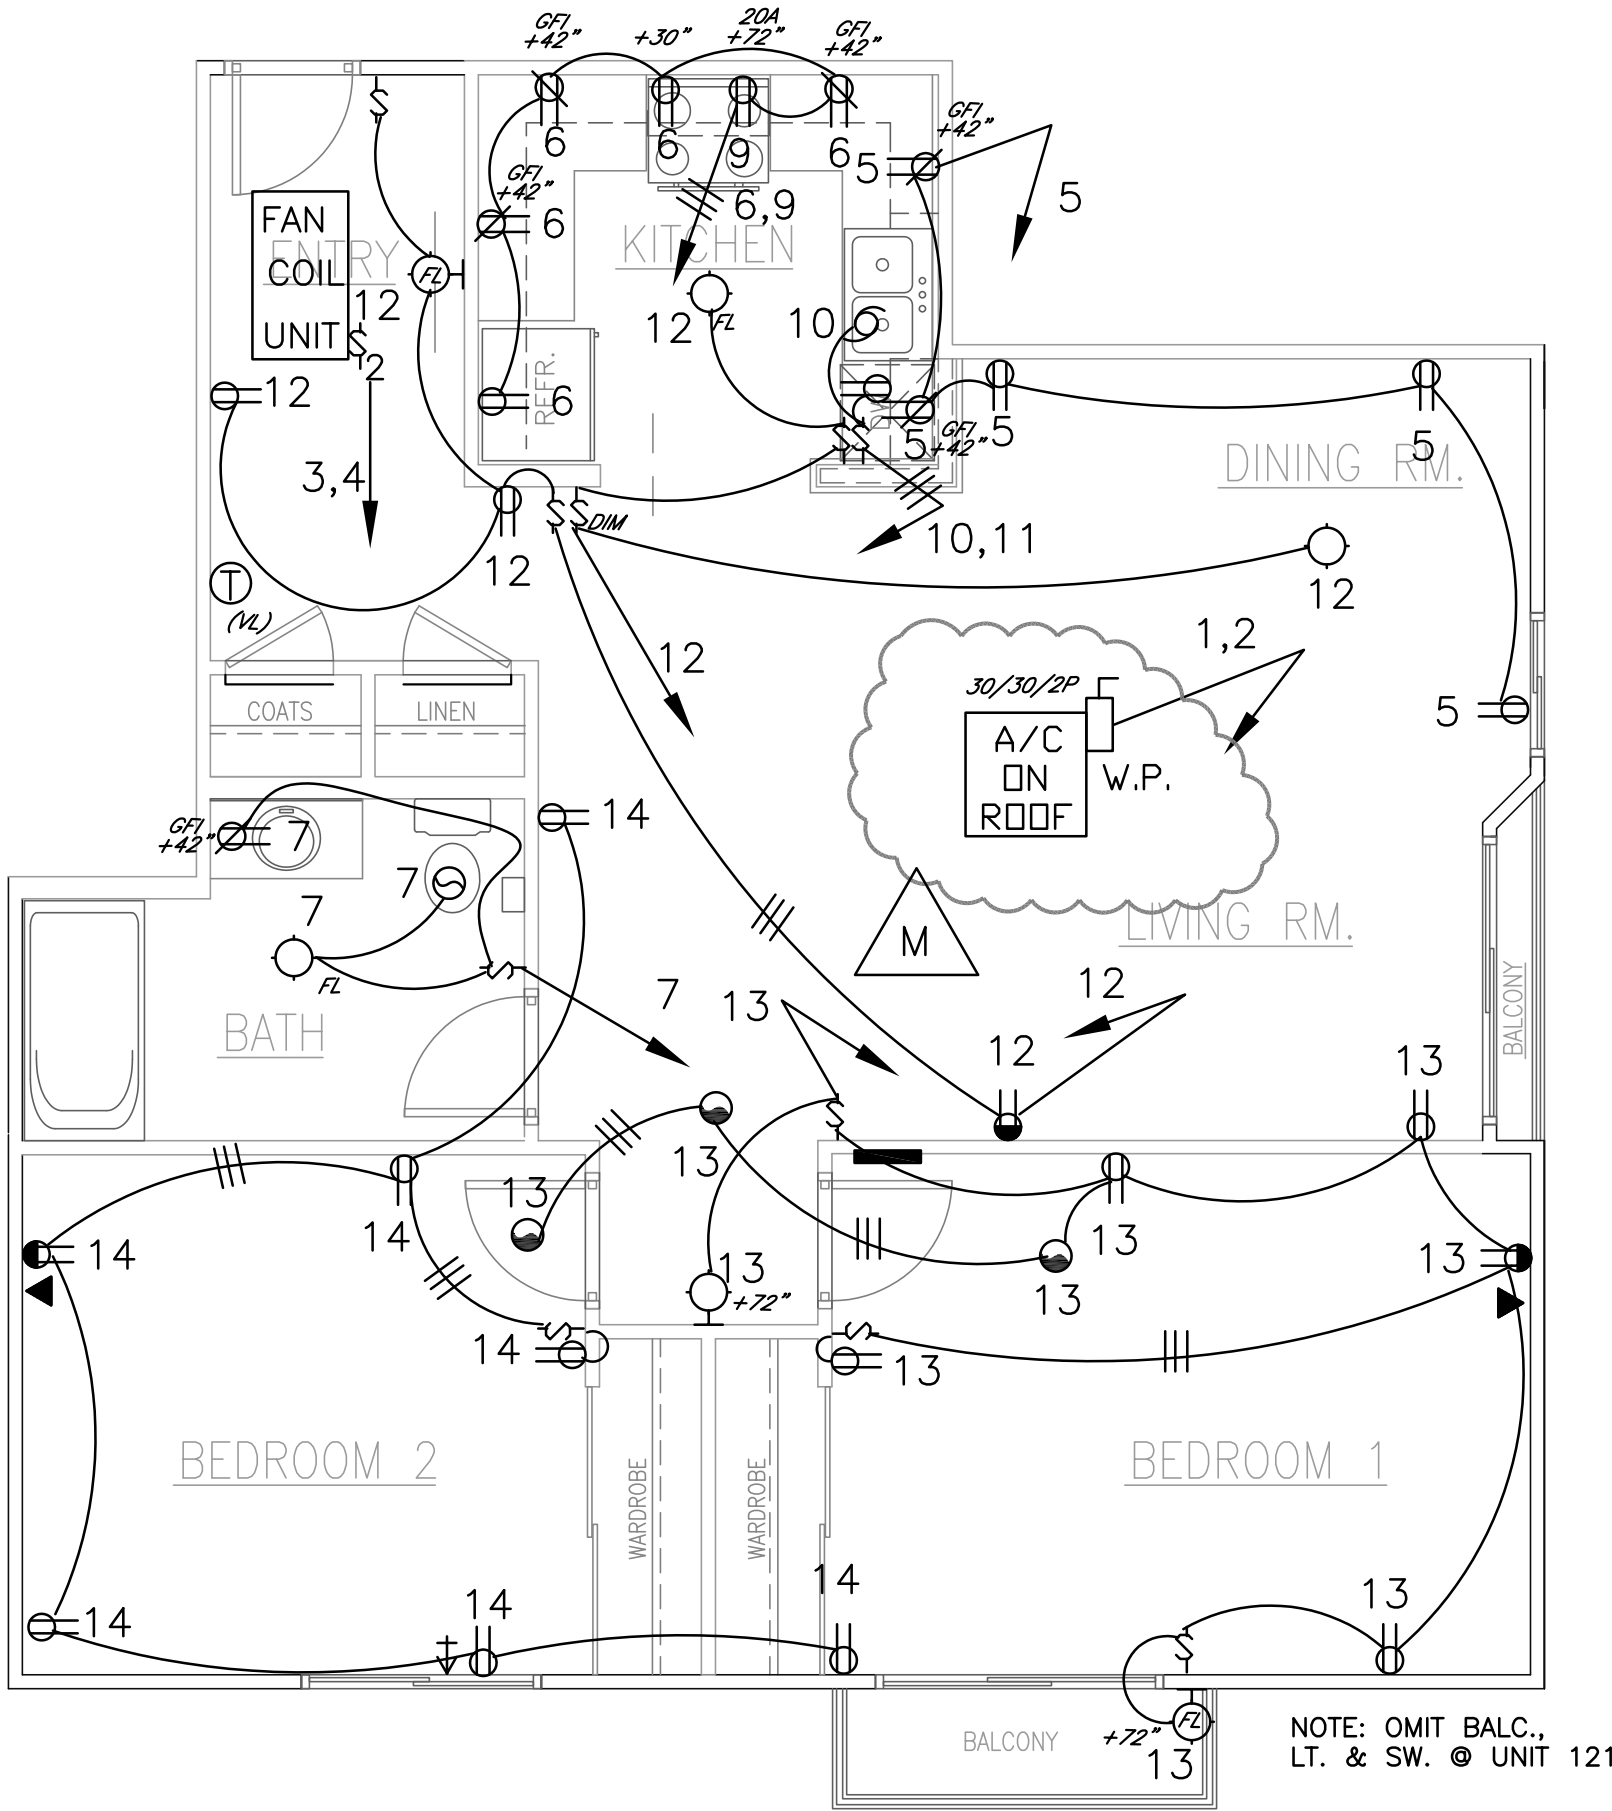

FLOOR PLAN ROOM TYPE "D"
UNITS 121, 221, 321, 421

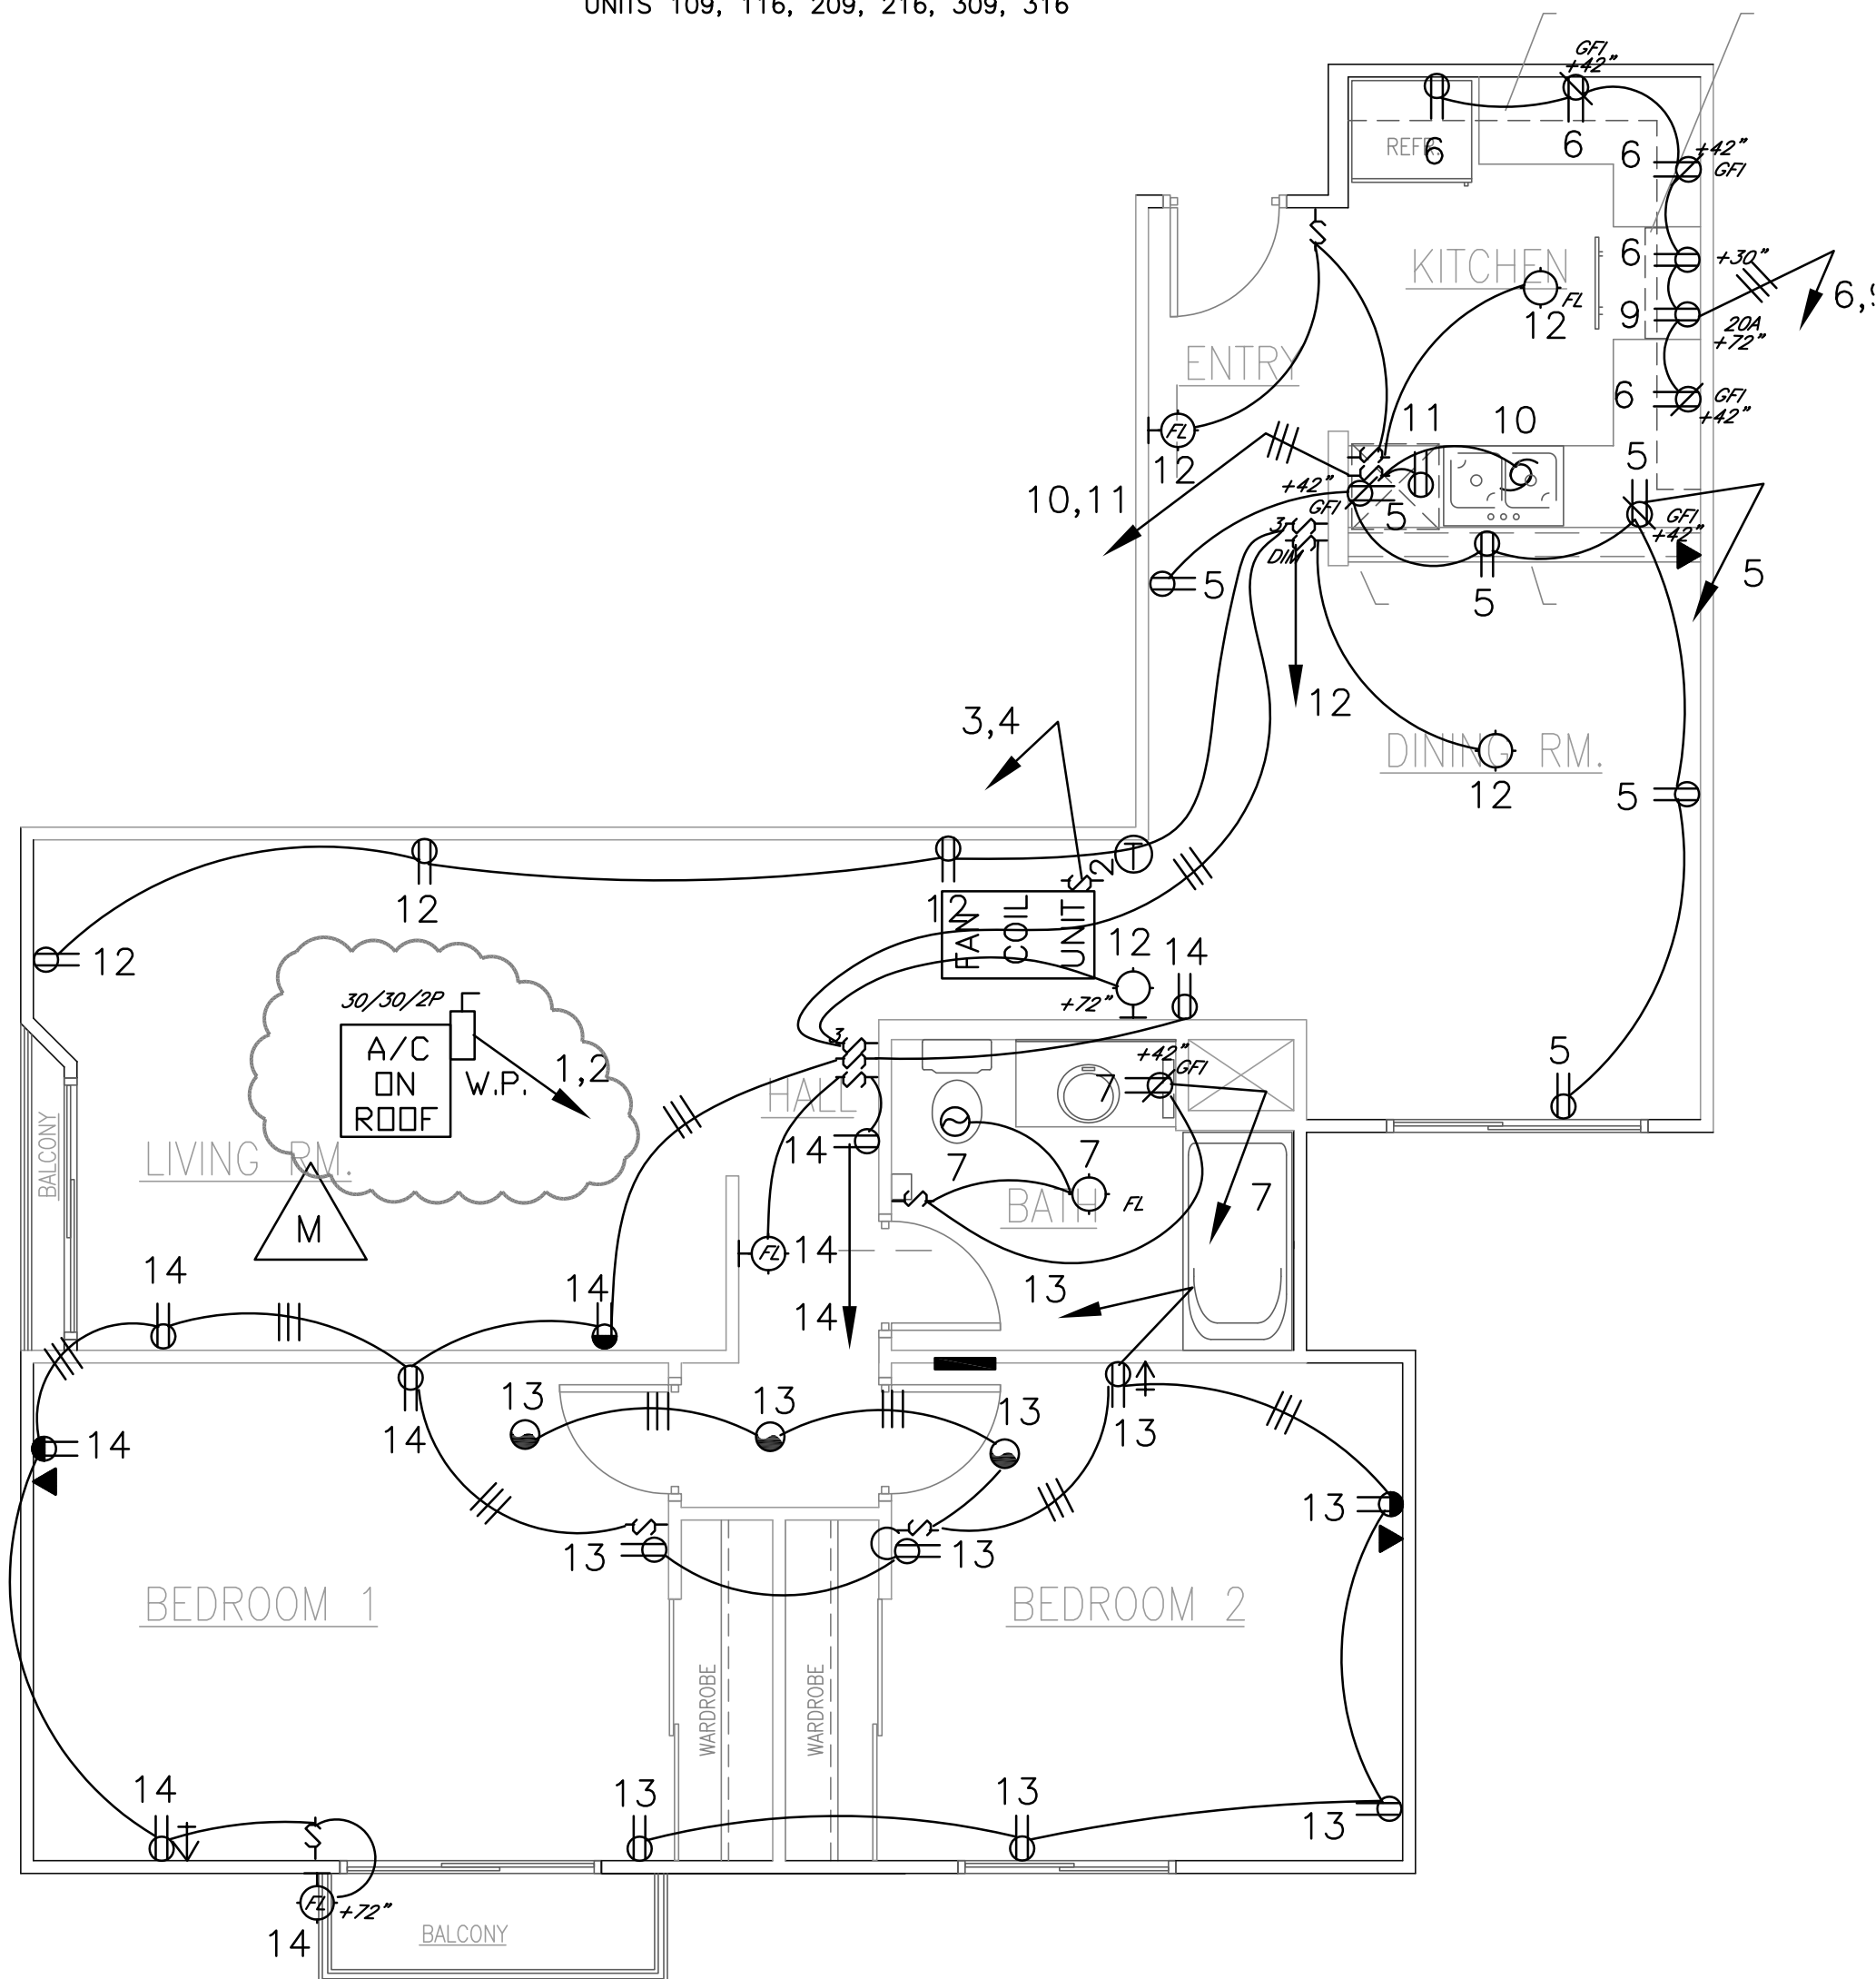

FLOOR PLAN ROOM TYPE "B"
UNITS 105, 205, 305, 405

APARTMENT UNIT NOTES & SYMBOLS

- SURFACE FLUOR. LIGHT IN BATHROOMS & KITCHEN SHALL PROVIDE 40 LUMENS/WATT (i.e. FLUORESCENT).
- TYPICAL 24 CIRCUIT, 125 AMPERE RESIDENTIAL SUB PANEL
- SMOKE DETECTORS SHALL BE HARD WIRED W/ BATTERY INCLUDED & MUST INTERCONNECT IN THE UNIT SO ALL RING TOGETHER WITHIN THE UNIT (3 WIRE RUN)
- ABOVE COUNTER G.F.I. RECEPTACLE IN ALL BATHROOMS (VERIFY HEIGHT) SHALL BE ON THEIR OWN CIRCUIT AS SHOWN
- ⬇ CATV OUTLET
- ⬇ TELEPHONE OUTLET
- ⊖ THERMOSTATE
- ⊖ STANDARD SWITCH
- ⊖ 3-WAY SWITCHING
- ⊖ 4-WAY SWITCHING
- ⊖ DIMMER SWITCH
- ⊖ BATH ROOM FAN (50 WATTS)
- ⊖ STANDARD DUPLEX RECEPTACLE
- ⊖ WALL SCONCE INCAND. LIGHT FIXTURE
- ⊖ SURFACE MOUNT INCAND. LIGHT FIXTURE
- ⊖ +30" RECEPT. (DEAD END) FOR OVEN/STOVE LIGHT
- ⊖ +72" FOR 20A. RECEPT. MICROWAVE/HOOD COMBO
- ⊖ TYPICAL KITCHEN COUNTER TOP RECEPTACLE SHALL BE G.F.I. PROTECTED-MOUNT +42"
- ⊖ STANDARD DUPLEX RECEPTACLES IN RESIDENTIAL UNITS SHALL BE +12" (ONLY COMMON AREA PLUGS OR HANDICAP UNITS TO BE +15")
- NOTE: SWITCHES, RECEPTACLES & ASSOCIATED COVER PLATES SHALL BE WHITE "DECORA" STYLE. VERIFY W/ THE OWNER WHEN BIDDING.
- [AFCI] = ARC FAULT CIRCUIT INTERRUPTER BREAKER
- INSTALL PLASTER RING & APPROPRIATE COVER PLATE FOR T-STAT, TELE & TV/CATV OUTLETS. VERIFY CONDUIT RUNS AND INSTALL ALL PULL WIRE IN ALL OF THESE "HOMERUN" CONDUITS (VERIFY ALL INSTALLATIONS).
- ⊖ WALL SCONCE FLUORESCENT LIGHT FIXTURE
- ⊖ PC
- NOTE: ALL AIR CONDITIONING UNIT EQUIPMENT FUSES SHALL BE OF TYPE "FUSETRON DUAL-ELEMENT TIME DELAY FUSES."