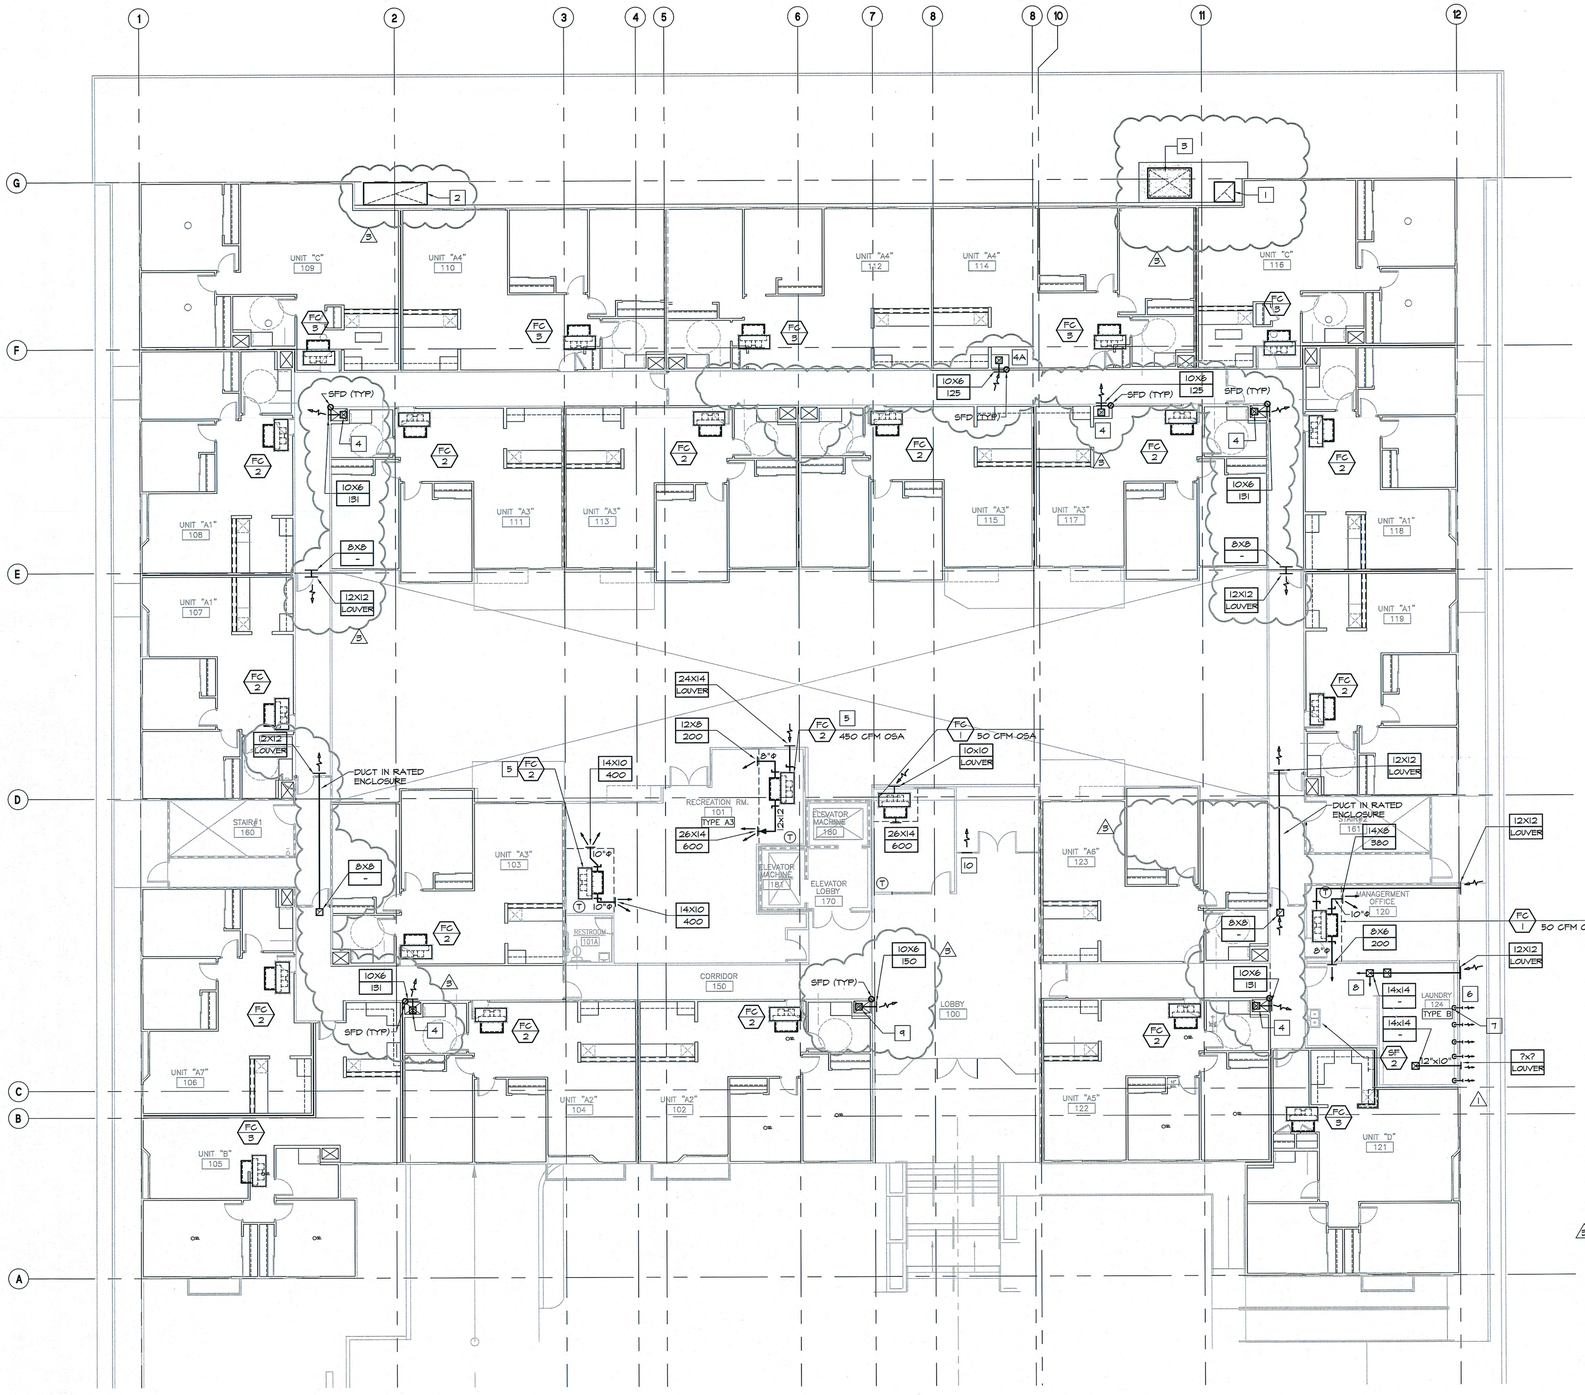

INDICATES FULL HIGHT RATED CORRIDOR WALLS SEE ARCH. DRAWINGS.

SEE PARTIAL HVAC PLANS ON SHEETS M-3.0, M-3.1 & M-3.2 FOR AIR DISTRIBUTION LAYOUT AT EACH UNIT.

HVAC KEY NOTES

1. 36"x34" EA DUCT UP & DOWN.
2. 114"x40" E.A. DUCT UP & DOWN.
3. 48"X72" RELIEF HOOD GREENECK FABRA, OR EQUAL.
4A. 6"X6" E.A. DUCT UP.
4. 6x6 OSA DUCT UP.
5. CASED UNIT WITH HINGED ACCESS PANEL.
6. 4" METAL DRYER VENT PIPE TERMINATION ON EXT. WALL, 3' FROM P.L. & OPENING TO BUILDING (TYP.)
7. 4" DRYER VENT PIPE DN TO DRYER (TYP., 14' LENGTH AND (2) 90 DEEGREE ELBOWS MAX.)
8. LAUNDRY ROOM EXHAUST AND MAKEUP AIR DUCTS SHALL BE SHEET METAL.
9. 8"X6" OSA DUCT UP.
10. 14"X10" RELIEF LOUVER

jag architecture
15 HUBBLE IRVINE CALIFORNIA 92618
(949) 752-9333
FAX (949) 752-1287
CONSULTANT

CLIENT

Saticoy Realty Investments, LLC
LOS ANGELES, CALIFORNIA

PROJECT

APARTMENT BUILDING
20223-20237 W. SATICOY STREET
WINNETKA, CALIFORNIA

DRAWING TITLE

FIRST FLOOR HVAC PLAN

REVISION

2 10-24-08 OWNER CO
3 03-18-09 P.C. REV.

STAMP

Nov 30, 2010
Expiration Date
REGISTERED PROFESSIONAL ENGINEER
CHRISTOPHER DAVAR
No. M 27015
MECHANICAL
STATE OF CALIFORNIA
03/20/09

DAVAR & ASSOC.
CONSULTING ENGINEERS
12016 Telegraph Road, Suite 205
Santa Fe Springs, California 90670
Tel. (562) 777-8050 Fax. (562) 777-0155

DATA

DATE: 07-20-2006
DRAWN BY: RM
J&G NO. 030703
SCALE: AS NOTED
SHEET

M-1.1.3

ALL DRAWINGS AND WRITTEN MATERIAL APPEARING HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE ARCHITECT AND THE SAME MAY NOT BE DUPLICATED, USED OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.